









Unterspannungsschalter TP 3251

No Volt switch TP 3251

Drucktaster push buttons

| Art. Nr. | AC3 / 230 V / 14,5 A | AC3 / 230 V / 10 A | AC3 / 115 V / 14,5 A | AC3 / 115 V / 10 A | 50 HZ | 60 HZ | Abdeckung transparent* | Dichtung | ausgestrichle Spule |
|------------|----------------------|--------------------|----------------------|--------------------|-------|-------|------------------------|----------|---------------------|
| 306.200.01 | • | | | | • | • | • | | |
| 306.201.01 | • | | | | • | • | • | • | |
| 306.202.01 | • | | | | • | • | • | • | |
| 306.300.02 | • | | | | • | • | • | • | |
| 306.300.03 | • | | | | • | • | • | • | |
| 306.301.01 | | • | | | • | • | • | • | |
| 306.302.01 | | • | | | • | • | • | • | |
| 306.303.01 | • | | | | • | • | • | • | • |
| 306.303.02 | • | | | | • | • | • | • | • |
| 306.304.01 | | • | | | • | • | • | • | • |
| 306.305.01 | | • | | | • | • | • | • | • |
| 306.400.01 | • | | | | • | • | • | • | • |
| 306.401.01 | | • | | | • | • | • | • | • |
| 306.402.01 | • | | | | • | • | • | • | • |
| 555.109 | | • | | | • | • | • | • | • |
| 555.199 | | • | | | • | • | • | • | • |
| 555.164 | | • | | | • | • | • | • | • |
| 555.986 | • | | | | • | • | • | • | • |

300.957 / 300.941 / 300.955 IP 65 im Tastenbereich
300.902 IP 65 sealing kit

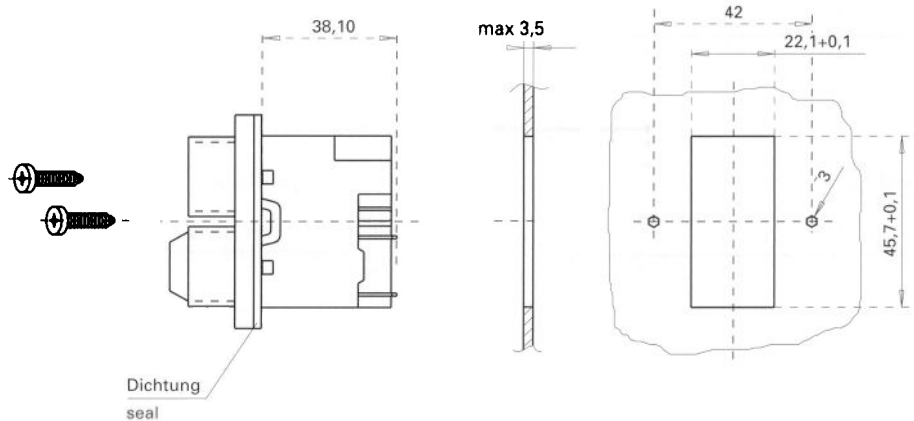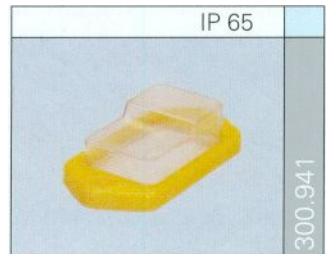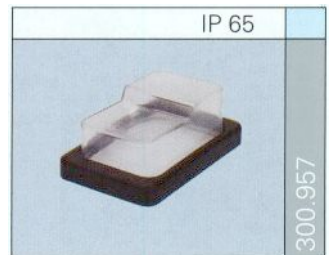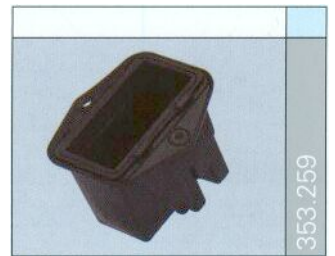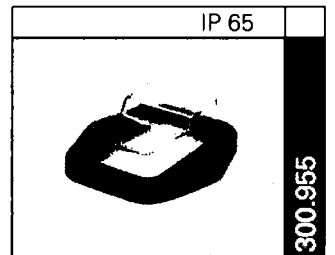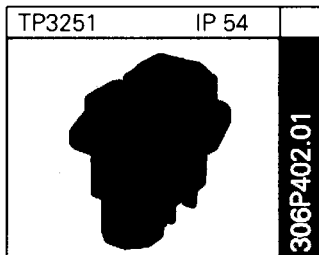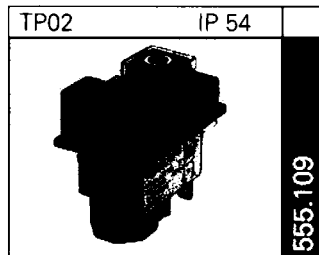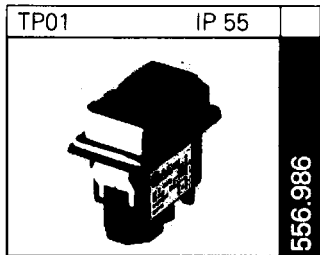

TP 3251 AC1 230 V / 16 A AC3 230 V / 14,5 A
TP 01 / 02 AC3 230 V / 10,0 A




Unterspannungsschalter TP 3251

No Volt switch TP 3251


Wippschalter
rocker switches

| Art. Nr. | AC3 / 230 V / 14,5 A | AC3 / 240 V / 14,5 A | AC3 / 115 V / 14,5 A | AC3 / 120 V / 14,5 A | 50 HZ | 60 HZ | Abdeckung transparent* | Dichtung | ausgeführte Spule |
|------------|----------------------|----------------------|----------------------|----------------------|-------|-------|------------------------|----------|-------------------|
| 306P000 | • | | | | | | | | |
| 306P000.01 | • | | | | | | | | |
| 306P005 | • | | | | | | | | |
| 306P005.01 | • | | | | | | | | |
| 306P003 | • | | | | | | | | |
| 306P003.01 | • | | | | | | | | |
| 306P009.01 | • | | | | | | | | |
| 306P001 | | • | | | | | | | |
| 306P001.01 | | • | | | | | | | |
| 306P007 | | • | | | | | | | |
| 306P007.01 | | • | | | | | | | |
| 306P002 | | • | | | | | | | |
| 306P002.01 | | • | | | | | | | |
| 306P006 | | • | | | | | | | |
| 306P006.01 | | • | | | | | | | |
| 306P008.01 | | • | | | | | | | |
| 306P004 | | • | | | | | | | |
| 306P004.01 | | • | | | | | | | |


300.902 IP 54 im Schaltbereich
300.902 IP 54 sealing kit

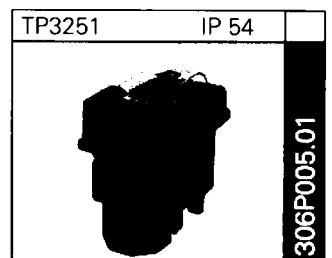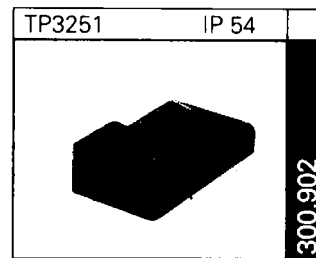

Schalter ohne ausgeführte Spule (A1)
Mit Steckanschlüssen 6,3 x 0,8
Switch without remote trip (A1)
With plug connection 6,3 x 0,8



Schalter mit ausgeführter Spule (A1)
Mit Steckanschlüssen 6,3 x 0,8 / 2,8 x 0,8 (A1)
Switch with remote trip (A1)
With plug connection 6,3 x 0,8 / 2,8 x 0,8 (A1)

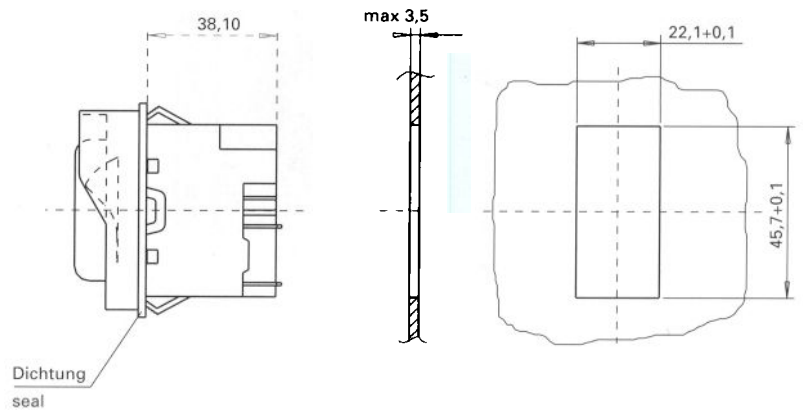

TP 3251 AC1 230 V / 16 A
TP 01 / 02

AC3 230 V / 14,5 A
AC3 230 V / 10,0 A